



GENERAL CHARACTERISTICS

ADJUSTABLE level control for the monitoring of liquids both in industrial and civil environment. Proposed in 2 standard versions of rod length, all intermediate lengths are obtained by the user simply shortening the rod of the float.

The principle of operation of these instruments is based on the drive of a reed switch, located in the head of the instrument, as a result of the hydrostatic thrust exerted by the liquid on the float.

The absence of moving parts guarantees extreme ruggedness and a limited need for maintenance.



- **ADJUSTABLE** switching point.
- Closed cell float.
- SPST or SPDT sealed contact.
- Operating ambient temperature -30 / +55 ° C - 90% RH.
- Easy mounting, threaded or flanged.
- DIN 43650 Plug.
- Minimum degree of protection IP65.

TECHNICAL DATA

Tab.1

		Description						Code
Float		SPANSIL –Butadiene Acrylonitrile Copolymer closed cells						B77
Rod length L0 mm		$\varnothing 30 \times 77$ mm		S.G. 0,4		10 Bar		
Process connection		AISI 316	0500			1000		
Electrical contact		Nickel plated brass	Threaded	1" UNI 228/1 male thread	SW 40			25GB
			Flanged	Double fixing (2 or 3 holes)	$\varnothing 55$ mm			FBPX
Electrical output		SPST	N.C.	N.O. See Tab.2	250V	80W	80VA	1,3A
		SPDT		Changeover contact	230V	60W	60VA	1,0A
Max. temperature °C		105 °C						L
Sealing gasket		NBR flat gasket anti-oil						1


WIRING

Tab.2


I	Independent	Separately wired contact
2	NC	Contact status
3	SPDT	in no level condition

1	NO	See instructions for adjusting
---	----	--------------------------------


NO CONTACT



NC CONTACT



SPDT CONTACT

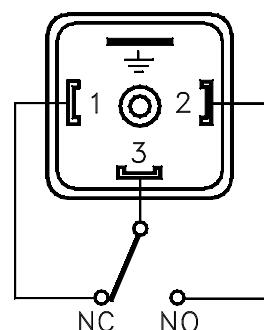


DIMENSIONS

L1	LT	LT
Switch point	$\gamma = 1$	$\gamma = 0,8$
160	145	161
180	166	181
200	187	202
220	207	223
240	228	243
260	249	264
280	270	284
300	290	305
320	311	326
340	332	346
360	353	367
380	373	388
400	394	408
420	415	429
440	436	450
460	457	470
480	477	491
500	498	512
520	519	532
540	540	553
560	560	573
580	581	594
	-	-
	-	-

Tab.3

L1	LT	LT
Switch point	$\gamma = 1$	$\gamma = 0,8$
600	602	615
620	623	635
640	643	656
660	664	677
680	685	697
700	706	718
720	727	739
740	747	759
760	768	780
780	789	801
800	810	821
820	830	842
840	851	862
860	872	883
880	893	904
900	913	924
920	934	945
940	955	966
960	976	986
980	996	1007
1000	1017	1028
	-	-
	-	-

Dimensions in mm.

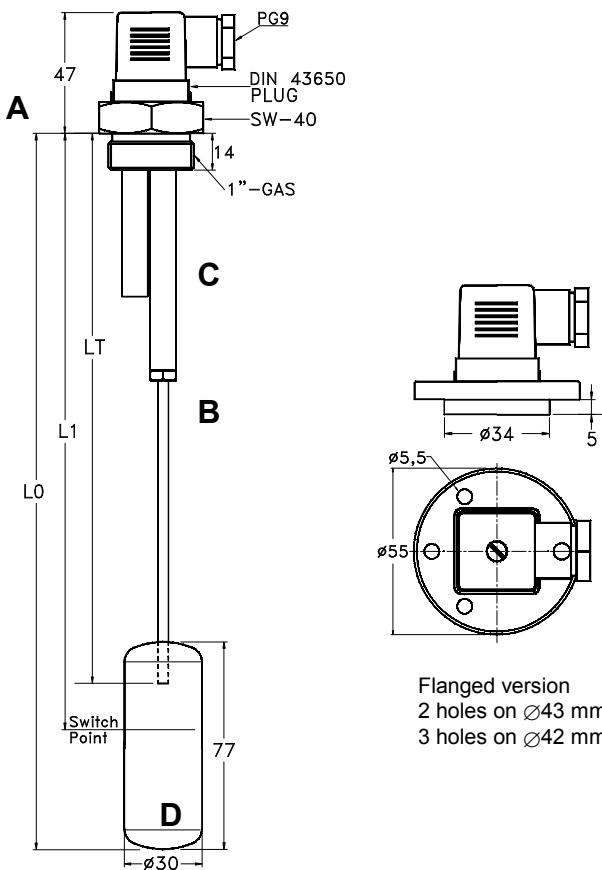

Flanged version
2 holes on Ø43 mm
3 holes on Ø42 mm

SETTING INSTRUCTIONS

Changing the function of the contact from NC to NO

Only on models with SPST contact

- Remove the float (D) from the metal rod by rotating and pulling it.
- Loosen the lock nut (B).
- Remove the spring and the brass spacer from stainless steel pipe.
- Insert the brass spacer into the brass tube (C).
- Reinsert the spring on stainless steel pipe.
- Reinsert the entire assembly in the tube, taking care to tighten the nut very well (B).
- Reinsert the float (D) taking care not to damage the silicone ring mounted inside the float itself.
- Perform the inverse operation to change the function of the contact from NO to NC**

Adjustment of the switch point and rod length

- Remove the float (D) from the metal rod by rotating and pulling it.
- Measure the rod from the top of the connector (A) to the detected value in the table Tab.3 according to the desired switch point and the specific gravity γ of the liquid used.
- The measurement should be carried out with the stainless steel tube fully extended outwards.
- Cut the stainless steel tube at length just measured with a pipe-cutter for 4 mm \varnothing and eliminate cutting burrs.
- Replace the float (D) taking care not to damage the silicone ring mounting inside the float itself.

NOMENCLATURE

R1	B77	4	0500	S	25GB	S1	L	1	I2
•									
	•								
		•							
			•						
				•					
					•				
						•			
							•		
								•	
									•

Type

Tab.1 Float

Tab.1 Electrical contact

Tab.3 Total length = L0 mm.

Tab.1 Rod material

Tab.1 Process connection

Tab.1 Electrical output

Tab.1 Temperature class

Tab.1 Sealing gasket

Tab.2 Wiring